



P2.1. Determine the deadweight of a 1-ft-long segment of the reinforced concrete beam whose cross section is shown in Figure P2.1. Beam is constructed with light-weight concrete which weighs 120 lbs/ft<sup>3</sup>.

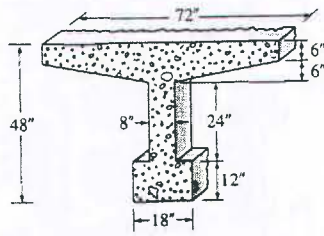

P2.1


COMPUTE THE WEIGHT/FT. OF CROSS SECTION @ 120 LB/FT<sup>3</sup>.

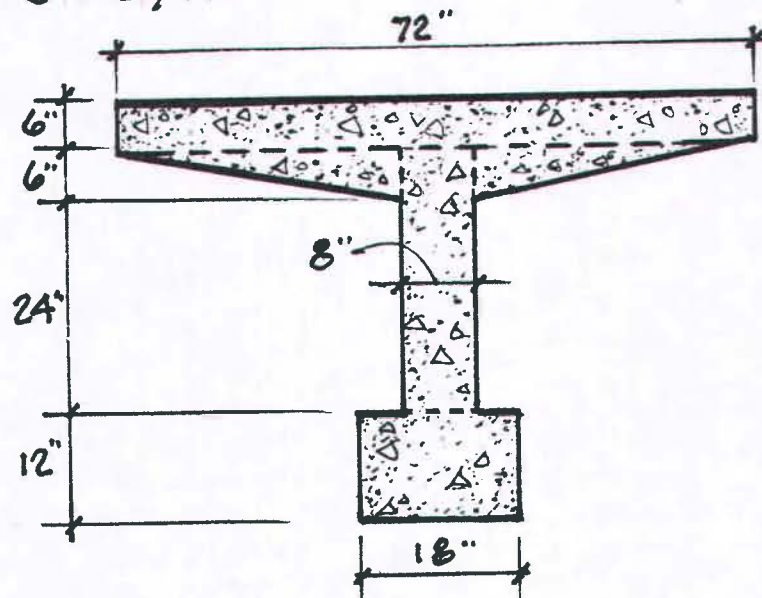

COMPUTE CROSS SECTIONAL AREA:  
$$\text{AREA} = (0.5' \times 6') + 2\left(\frac{1}{2} \times 0.5' \times 2.67'\right) + (0.67' \times 2.5') + (1.5' \times 1')$$
$$= 7.5 \text{ FT}^2$$


WEIGHT OF MEMBER PER FOOT LENGTH:  
$$\text{WT/FT} = 7.5 \text{ FT}^2 \times 120 \text{ LB/FT}^3 = \underline{\underline{900 \text{ LB/FT}}}$$

P2.2. Determine the deadweight of a 1-m-long segment of the reinforced concrete girder in Figure P2.2 constructed from lightweight concrete with a unit weight of  $16 \text{ kN/m}^3$ .

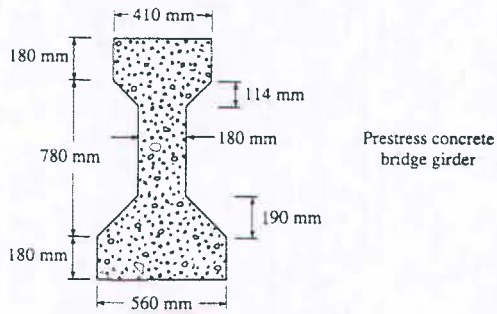

P2.2


compute the weight/m of the  
CROSS SECTION

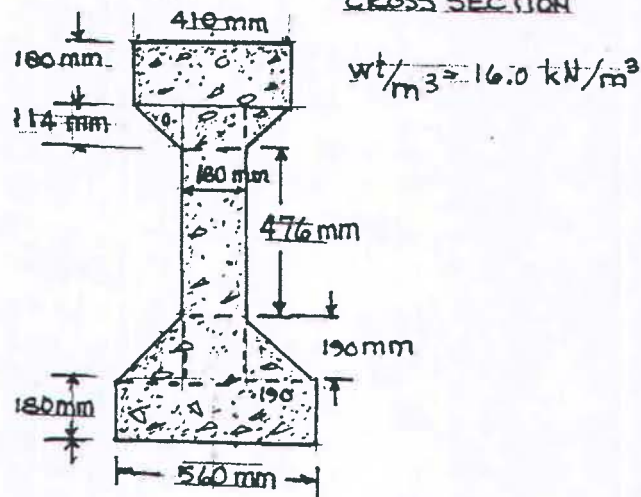


$$\begin{aligned} \text{AREA} &= (.410 \times .18) + 2 \left( \frac{.114 \times .114}{2} \right) \\ &+ .180 \times .476 + 2 \left( \frac{.190 \times .190}{2} \right) \\ &+ .560 \times .180 + (.114 + .190) \times .180 \\ &= 0.3642 \text{ m}^2 \end{aligned}$$

$$\text{WT/m} = 0.3642 \times 16 \text{ kN/m}^3 = \underline{\underline{5.83 \frac{\text{kN}}{\text{m}}}}$$

**P2.3.** Determine the deadweight of a 1-ft-long segment of a typical 20-in-wide unit of a roof supported on a nominal 2 in × 16 in southern pine beam (the actual dimensions are  $\frac{1}{2}$  in smaller). The  $\frac{3}{4}$ -in plywood weighs 3 lb/ft<sup>2</sup>.

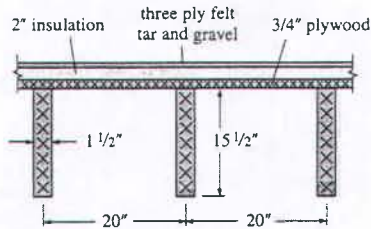

P2.3

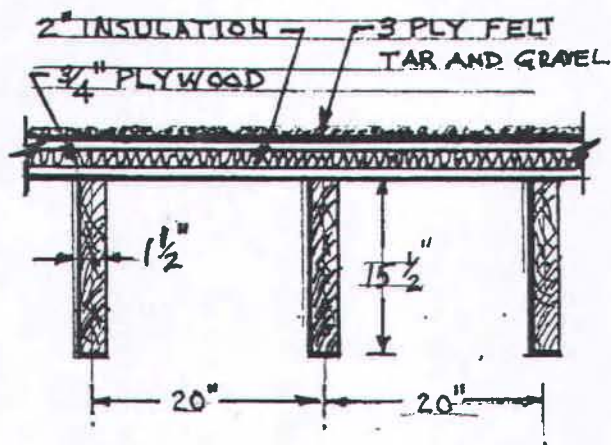

SEE TABLE 2.1 FOR WEIGHTS

WT/20" unit

$$\text{PLYWOOD: } 3 \text{ psf} \times \frac{20}{12} \times 1' = 5 \text{ lb}$$

$$\text{INSULATION: } 3 \text{ psf} \times \frac{20}{12} \times 1' = 5 \text{ lb}$$

$$\text{ROOF TAR \& G: } 55 \text{ psf} \times \frac{20}{12} \times 1' = 9.17 \text{ lb}$$


$$\underline{19.17 \text{ lb}}$$

$$\text{WOOD JOIST} = \frac{37 \text{ lb}}{\text{ft}^3} \times \frac{(1.5' \times 15.5') \times 1'}{144 \text{ in}^2/\text{ft}^2} = 5.97 \text{ lb}$$

$$\text{TOTAL WT OF 20" UNIT} = 19.17 + 5.97$$


$$= \underline{25.14 \text{ lb Ans.}}$$

P2.4. Consider the floor plan shown in Figure P2.4. Compute the tributary areas for (a) floor beam B1, (b) girder G1, (c) girder G2, (d) corner column C3, and (e) interior column B2.

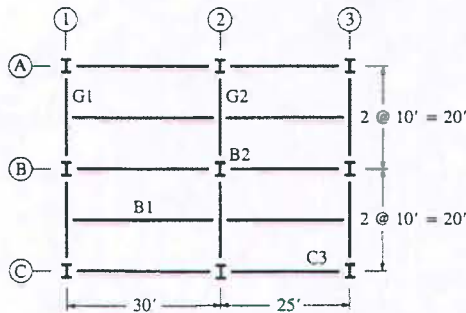


P2.4

COMPUTE TRIBUTARY AREAS,  $A_T$

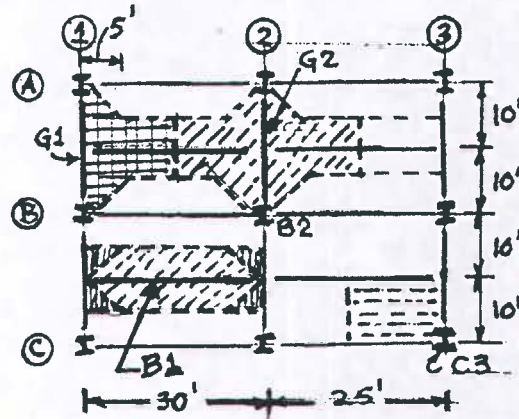

(a) BEAM B1 SPAN 30 ft.  
METHOD 1: UNIFORM LOAD OVER 30'  
 $A_T = 30(5+5) = \underline{300 \text{ FT}^2}$


METHOD 2: TAPER LOADS AT ENDS

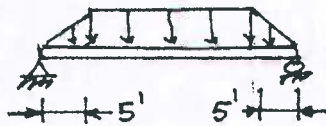

$$A_T = 300 - 4(5 \times 5 \times \frac{1}{2}) = \underline{250 \text{ ft}^2}$$


(b) GIRDER G1 SPAN 20 ft.

METHOD 1: UNIFORM LOAD

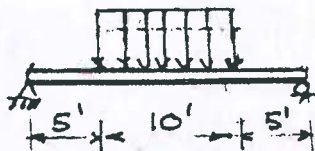

$$A_T = 10 \times 15 = \underline{150 \text{ ft}^2}$$

METHOD 2: ADD TAPERED LOADS AT ENDS

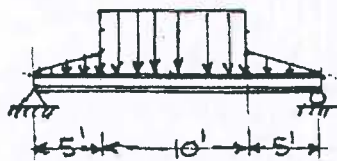


$$A_T = 150 + (5 \times 5 \times \frac{1}{2}) \times 2$$

$$A_T = \underline{175 \text{ ft}^2}$$


(c) GIRDER G2 SPAN 20 ft

METHOD 1: UNIFORM LOAD



$$A_T = (20/2 + 25/2) \times 10 = \underline{275 \text{ ft}^2}$$

METHOD 2: TAPER LOAD AT ENDS



$$A_T = 275 + 4[5 \times 5] \times \frac{1}{2} = \underline{325 \text{ ft}^2}$$

(d) COLUMN C3


$$A_T = 25/2 \times 10 = \underline{125 \text{ ft}^2}$$

(e) COLUMN B2

$$A_T = (15 + 12.5) \times (10 + 10)$$

$$A_T = \underline{550 \text{ ft}^2}$$

P2.5. Refer to Figure P2.4 for the floor plan. Calculate the influence areas for (a) floor beam B1, (b) girder G1, (c) girder G2, (d) corner column C3, and (e) interior column B2.

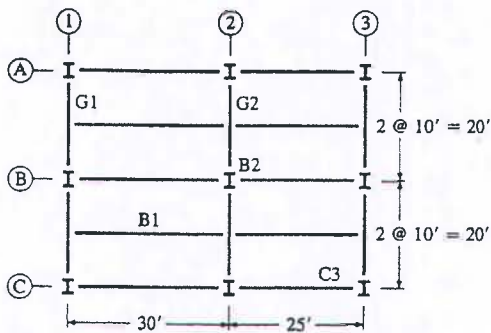

P2.4

Multiply the values of  $A_T$  in problem P2.4 by  $K_{LL}$ , where  $K_{LL} = 4$  for columns and 2 for beams.

BEAM B1

METHOD 1  $K_{LL}A_T = 2(300\text{ FT}^2) = 600\text{ FT}^2$

METHOD 2  $K_{LL}A_T = 2(500\text{ FT}^2) = 500\text{ FT}^2$

GIRDER G1

METHOD 1  $K_{LL}A_T = 2(150\text{ FT}^2) = 300\text{ FT}^2$

METHOD 2  $K_{LL}A_T = 2(175\text{ FT}^2) = 350\text{ FT}^2$

GIRDER G2


METHOD 1  $K_{LL}A_T = 2(275\text{ FT}^2) = 550\text{ FT}^2$

METHOD 2  $K_{LL}A_T = 2(325\text{ FT}^2) = 650\text{ FT}^2$

COLUMN C3  $K_{LL}A_T = 4(125\text{ FT}^2) = 500\text{ FT}^2$

COLUMN B2  $K_{LL}A_T = 4(550\text{ FT}^2) = 2,200\text{ FT}^2$

P2.6. The uniformly distributed live load on the floor plan in Figure P2.4 is 60 lb/ft<sup>2</sup>. Establish the loading for members (a) floor beam B1, (b) girder G1, and (c) girder G2. Consider the live load reduction if permitted by the ASCE standard.

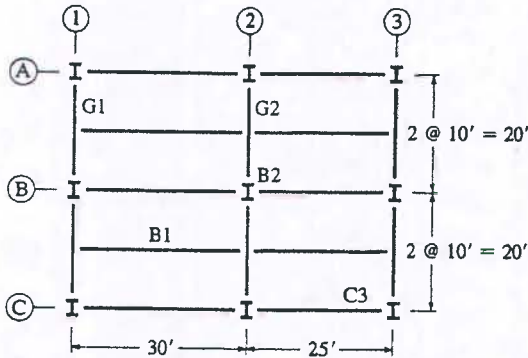

P2.4

Values of  $A_T$  are evaluated in Prob 2.4. Use simplified loading


(a) Loading for B1

$$K_{LL} A_T = 2 \times 300 = 600 > 400$$

$$L = L_o \left( 0.25 + \frac{15}{\sqrt{K_{LL} A_T}} \right)$$

$$= 60 \left( 0.25 + \frac{15}{\sqrt{600}} \right) = 51.7 \text{ lb/ft}^2$$

$$\text{LIVE LOAD/FT} = \frac{51.7 \times 10}{1000} = 0.517 \text{ k/ft}$$

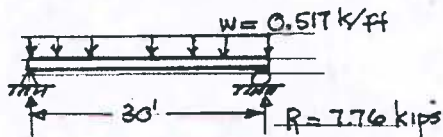


(b) LOADING for G1 supports load from a SINGLE 30ft beam (B1).


$$K_{LL} A_T = 2 \times 150 = 300 < 400$$

∴ NO REDUCTION ALLOWED

COMPUTE REACTION FROM BEAM B1

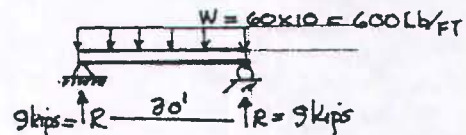

LOAD TO GIRDER G1 FROM B1





ESTABLISH LOAD FOR G2 WHICH SUPPORTS BEAMS OF 25' AND 30' AT ITS CENTER.


$$K_{LL} A_T = 2 (10) \left[ \frac{30}{2} + \frac{25}{2} \right] = 550 \text{ ft}^2 > 400$$

$$L = 60 \left( 0.25 + \frac{15}{\sqrt{550}} \right) = 53.4 \text{ lb/ft}^2$$


$$\text{LIVE LOAD/FT} = \frac{53.4 \times 10}{1000} = 0.534 \text{ kips/ft}$$




(c) LOAD TO GIRDER G2



P2.7. The elevation associated with the floor plan in Figure P2.4 is shown in Figure P2.7. Assume a live load of  $60 \text{ lb/ft}^2$  on all three floors. Calculate the axial forces produced by the live load in column B2 in the third and first stories. Consider any live load reduction if permitted by the ASCE standard.

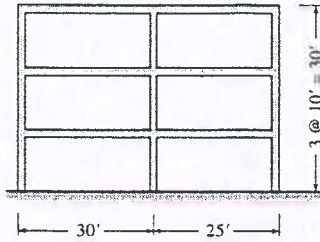


P2.7

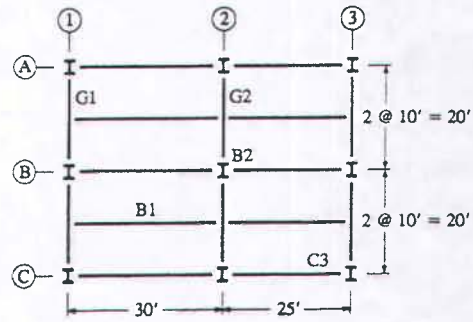

P2.4

COMPUTE THE LIVE LOAD FORCES IN COLUMN B2 IN P2.4  $W_L = 60 \text{ lb/ft}^2$

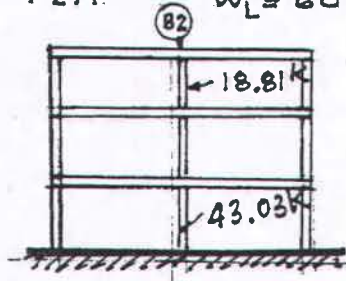

$$A_T = \left(\frac{30}{2} + \frac{25}{2}\right) 20 = 550 \text{ ft}^2$$

$$K_{LL} A_T = 4 \times 550 = 2,200 \text{ ft}^2 > 400 \text{ ft}^2$$

$\therefore$  Reduce  $W_L$

3<sup>RD</sup> story

$$W = W_L \left[ 0.25 + \frac{15}{\sqrt{K_{LL} A_T}} \right]$$

$$= 60 \left[ 0.25 + \frac{15}{\sqrt{2200}} \right] = 34.19 \text{ psf}$$

SINCE  $34.19 > 0.5 W_L = 30$ , USE  $34.19 \text{ psf}$

$$P = W A_T = \frac{34.19 (550)}{1000} = \underline{18.81 \text{ kips}}$$

1<sup>ST</sup> story

COLUMN supports 3 FLOORS

$$K_{LL} A_T = 4 (550 \times 3) = 6600 \text{ ft}^2$$

$(.4336) \therefore$  Reduce  $W_L$


$$W = 60 \left[ 0.25 + \frac{15}{\sqrt{6600}} \right] = \underline{26.08 \text{ psf}}$$

SINCE  $26.08 > .4 (60)$ , USE  $26.08 \text{ psf}$


$$P = W A_T = 26.08 (3 \times 550)$$

$$= \underline{43.03 \text{ kips}}$$



P2.8. A five-story building is shown in Figure P2.8. Following the ASCE standard, the wind pressure along the height on the windward side has been established as shown in Figure P2.8(c). (a) Considering the windward pressure in the east-west direction, use the tributary area concept to compute the resultant wind force at each floor level. (b) Compute the horizontal base shear and the overturning moment of the building.

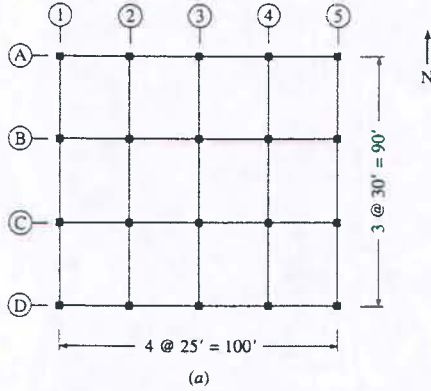

P2.8

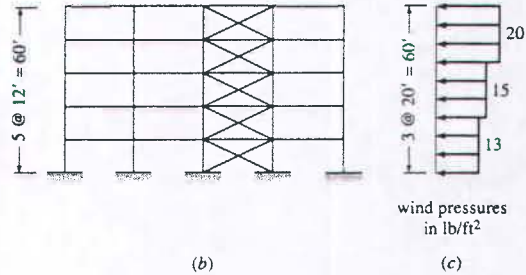

P2.8

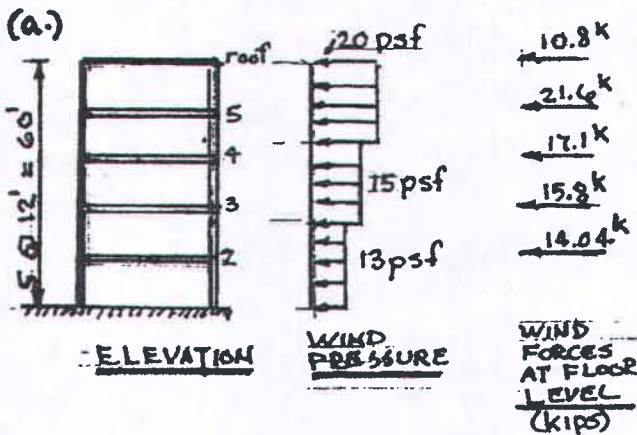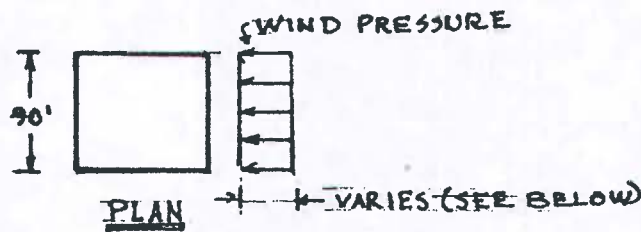

a) Resultant Wind Forces

Roof	20 psf (6 x 90) = 10,800 lb
5 <sup>th</sup> floor	20 psf (12 x 90) = 21,600 lb
4 <sup>th</sup> floor	20 psf (2 x 90) + 15 (10 x 90) = 17,100 lb
3 <sup>rd</sup> floor	15 psf (10 x 90) + 13 (2 x 90) = 15,800 lb
2 <sup>nd</sup> floor	13 psf (12 x 90) = 14,040 lb

b) HORIZONTAL BASE SHEAR  $V_{BASE}$


$\Sigma$  FORCES AT EACH LEVEL =  
 $10.8k + 21.6k + 17.1k + 15.8k + 14.04k =$   
 $V_{BASE} = \underline{79.34k}$

OVERTURNING MOMENT OF THE BUILDING =  $\Sigma$ (FORCE @ EA. LEVEL x HEIGHT ABOVE BASE)

$10.8k (60') + 21.6k (48') + 17.1k (36') +$   
 $15.8k (24') + 14.04k (12') =$

$M_{OVERTURNING} = \underline{2,848 \text{ Ft-k}}$

**P2.9.** The dimensions of a 9-m-high warehouse are shown in Figure P2.9. The windward and leeward wind pressure profiles in the long direction of the warehouse are also shown. Establish the wind forces based on the following information: basic wind speed = 40 m/s, wind exposure category = C,  $K_d = 0.85$ ,  $K_z = 1.0$ ,  $G = 0.85$ , and  $C_p = 0.8$  for windward wall and  $-0.2$  for leeward wall. Use the  $K_z$  values listed in Table 2.4. What is the total wind force acting in the long direction of the warehouse?

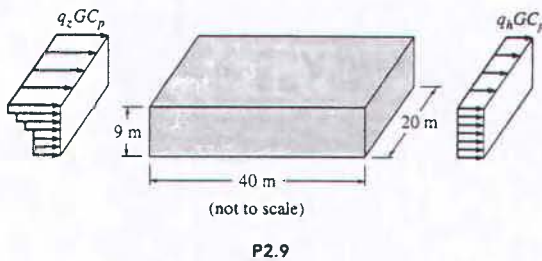

USE  $I = 1$

$$q_s = 0.613V^2 \quad (\text{EQ 2.4b})$$

$$= 0.613(40)^2 = \underline{980.8 \text{ N/m}^2}$$

$$q_z = q_s I K_z K_{zt} K_d$$

$$q_z = 980.8(1)K_z(1)(0.85) = \underline{833.7 K_z}$$

$$0 - 4.6 \text{ m: } q_z = 833.7(0.85) = 708.6 \frac{\text{N}}{\text{m}^2}$$

$$4.6 - 6.1 \text{ m: } q_z = 833.7(0.90) = 750.3 \frac{\text{N}}{\text{m}^2}$$

$$6.1 - 7.6 \text{ m: } q_z = 833.7(0.94) = 783.7 \frac{\text{N}}{\text{m}^2}$$

$$7.6 - 9 \text{ m: } q_z = 833.7(0.98) = 817.1 \frac{\text{N}}{\text{m}^2}$$

FOR THE WINDWARD WALL

$$p = q_z G C_p \quad (\text{EQ 2.7})$$

$$\text{where } G C_p = 0.85(0.8) = \underline{0.68}$$

$$p = 0.68 q_z$$

$$0 - 4.6 \text{ m } p = 481.8 \text{ N/m}^2$$

$$4.6 - 6.1 \text{ m } p = 512.2 \text{ N/m}^2$$

$$6.1 - 7.6 \text{ m } p = 532.9 \text{ N/m}^2$$

$$7.6 - 9 \text{ m } p = 555.6 \text{ N/m}^2$$

TOTAL WIND FORCE,  $F_w$ , WINDWARD WALL

$$F_w = 481.8[4.6 \times 20] + 512.2[1.5 \times 20]$$

$$+ 532.9[1.5 \times 20] + 555.6[1.4 \times 20]$$

$$\underline{F_w = 91,180 \text{ N}}$$

FOR LEEWARD WALL

$$p = q_h G C_p = q_h (0.85)(-0.2)$$

$$q_h = q_z \text{ at } 9 \text{ m} = 817.1 \text{ N/m}^2 \text{ (above)}$$

$$p = 817.1(0.85)(-0.2) = -138.9 \text{ N/m}^2$$

TOTAL WIND FORCE,  $F_L$ , ON LEEWARD WALL

$$F_L = (20 \times 9)(-138.9) = \underline{-25,003 \text{ N}^*}$$

$$\text{TOTAL FORCE} = F_w + F_L$$



$$= 91,180 + 25,003$$

$$= \underline{116,183.3 \text{ N}}$$

\* BOTH  $F_L$  AND  $F_w$  ACT IN SAME DIRECTION.


**P2.10.** The dimensions of a gabled building are shown in Figure P2.10a. The external pressures for the wind load perpendicular to the ridge of the building are shown in Figure P2.10b. Note that the wind pressure can act toward or away from the windward roof surface. For the particular building dimensions given, the  $C_p$  value for the roof based on the ASCE standard can be determined from Table P2.10, where plus and minus signs signify pressures acting toward and away from the surfaces, respectively. Where two values of  $C_p$  are listed, this indicates that the windward roof slope is subjected to either

positive or negative pressures, and the roof structure should be designed for both loading conditions. The ASCE standard permits linear interpolation for the value of the inclined angle of roof  $\theta$ . But interpolation should only be carried out **between** values of the same sign. Establish the wind pressures on the building when positive pressure acts on the windward roof. Use the following data: basic wind speed = 100 mi/h, wind exposure category = B,  $K_d = 0.85$ ,  $K_z = 1.0$ ,  $G = 0.85$ , and  $C_p = 0.8$  for windward wall and  $-0.2$  for leeward wall.

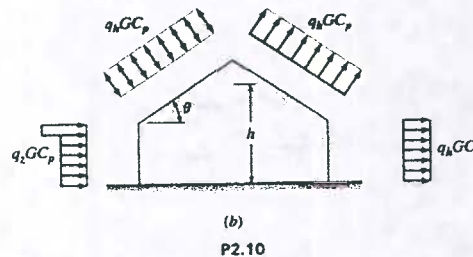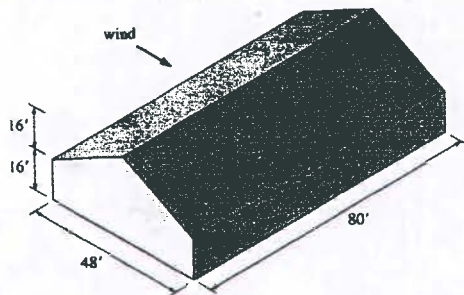

**TABLE P2.10** (a)  
**Roof Pressure Coefficient  $C_p$**  \* $\theta$  defined in Fig. P2.10

Angle $\theta$	Windward							Leeward			
	10	15	20	25	30	35	45	$\geq 60$	10	15	$\geq 20$
$C_p$	-0.9	-0.7	-0.4	-0.3	-0.2	-0.2	0.0	0.01 $\theta^*$	-0.5	-0.5	-0.6
			0.0	0.2	0.2	0.3	0.4				

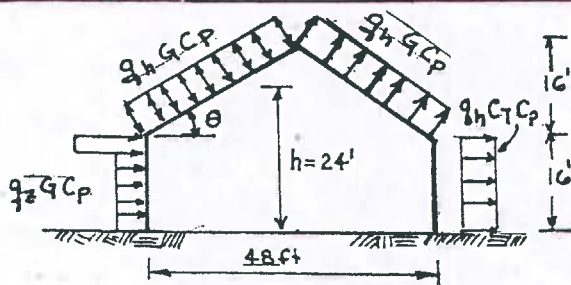

MEAN ROOF HEIGHT,  $h = 24$  ft  
 $\theta = \tan^{-1}(\frac{16'}{24'}) = 33.69^\circ$  (for Table 2.4)

CONSIDER POSITIVE WINDWARD PRESSURE ON ROOF, i.e. left side.

INTERPOLATE IN TABLE P2.10  
 $C_p = 0.2 + \frac{(33.69 - 30)}{(35 - 30)} \times 0.1$   
 $C_p = 0.2738$  (Roof ONLY)

FROM TABLE 2.4 (SEE p48 OF TEXT)

$K_z = 0.57, 0-15'$   
 $= 0.62, 15'-20'$   
 $= 0.66, 20'-25'$   
 $= 0.70, 25'-30'$   
 $0.76, 30'-32'$

$K_{zt} = 1.0, K_d = 0.85, I = 1$

$q_s = 0.00256 V^2$  (EQ 2.4a)  
 $q_s = 0.00256 (100)^2 = 25.6 \text{ lb/ft}^2$

$$q_z = q_s I K_z K_{zt} K_d$$

$$0-15'; q_z = 25.6 (1)(0.57)(1)(0.85) = 12.40 \text{ lb/ft}^2$$

$$15-16'; q_z = 13.49 \text{ lb/ft}^2$$

$$h=24'; q_z = 14.36 \text{ lb/ft}^2$$

WIND PRESSURE ON WINDWARD WALL & ROOF

$$p = q_z G C_p$$

WALL, 0-15';  $p = 12.40 \times 0.85 \times 0.80$   
 $p = 8.43 \text{ psf}$

WALL, 15'-16'  $p = 13.49 \times 0.85 \times 0.8 = 9.17 \text{ psf}$

Roof,  $p = 14.36 \times 0.85 \times 0.2738$   
 $p = 3.34 \text{ psf}$


WIND PRESSURE ON LEEWARD SIDE

FOR WALL  $p = q_h G C_p$


FOR  $h = 24'$ ;  $q_h = q_z = 14.36 \text{ lb/ft}^2$   
 $C_p = -0.2$  FOR WALL = 0.6 FOR ROOF  
 FOR WALL  $p = 14.36 (0.85)(-0.2)$   
 $p = -2.44 \text{ lb/ft}^2$

FOR ROOF  $p = 14.36 (0.85)(-0.6)$   
 $p = -7.32 \text{ lb/ft}^2$  (uplift)

P2.11. Establish the wind pressures on the building in Problem P2.10 when the windward roof is subjected to an uplift wind force.

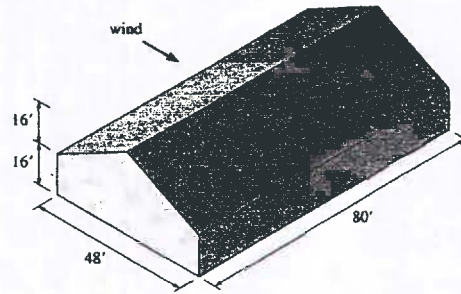

(a)

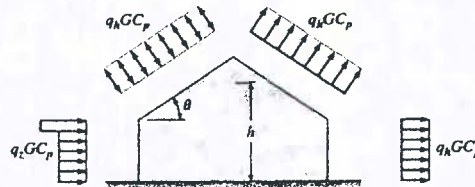

(b)  
P2.10

TABLE P2.10

Roof Pressure Coefficient  $C_p$

\* $\theta$  defined in Fig. P2.10

Angle $\theta$ $C_p$	Windward							Leeward			
	10	15	20	25	30	35	45	$\geq 60$	10	15	$\geq 20$
	-0.9	-0.7	-0.4	-0.3	-0.2	-0.2	0.0	0.01 $\theta^*$	-0.5	-0.5	-0.6
			0.0	0.2	0.2	0.3	0.4				

SEE P2.10 SOLUTION

WINDWARD ROOF (NEGATIVE PRESSURE)

$$\theta = 33.7^\circ$$


Interpolate between  $30^\circ$  and  $35^\circ$   
for negative  $C_p$  value in Table P2.10

$$C_p = -0.274$$

$$P = q_h G C_p = 21.76 (0.64) 0.85 (-0.274) \\ = -334 \text{ lb/ft}^2 \text{ (SUCTION)}$$

NOTE: Wind pressures on other  
3 surfaces are the same as in  
P2.10

P2.12. (a) Determine the wind pressure distribution on the four sides of the 10-story hospital shown in Figure P2.12. The building is located near the Georgia coast where the wind velocity contour map in Figure 2.15 of the text specifies a design wind speed of 140 mph. The building, located on level flat ground, is classified as *stiff* because its natural period is less than 1 s. On the windward side, evaluate the magnitude of the wind pressure every 35 ft in the vertical direction. (b) Assuming the wind pressure on the windward side varies linearly, determine the total wind force on the building in the direction of the wind. Include the negative pressure on the leeward side.

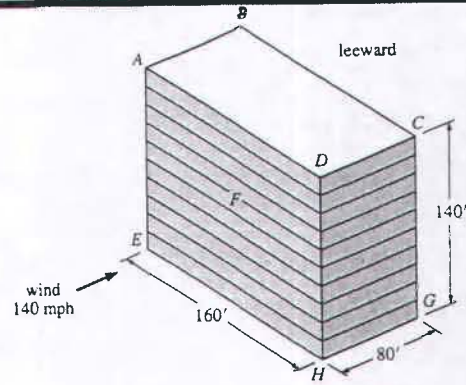

P2.12

(a) COMPUTE VARIATION OF WIND PRESSURE ON WINDWARD FACE

$$q_z = q_s I K_z K_{zt} K_d \quad \text{EQ 2.6}$$

$$q_s = 0.00256 V^2 \quad \text{EQ 2.4a}$$

$$= 0.00256 (140)^2$$

$$q_s = 50.176 \text{ psf; Round to } 50.18 \text{ psf}$$

$I = 1.15$  for hospitals  
 $K_{zt} = 1$ ;  $K_d = 0.85$   
 $K_z$  READ IN TABLE 2.4

ELEV. (ft)	0	35'	70'	105'	140'
$K_z$	1.03	1.19	1.34	1.44	1.52

$$q_z = 50.18 (1.15) (K_z) (1) (0.85)$$

$$q_z = 49.05 K_z$$

COMPUTE WIND PRESSURE  $p$  ON WINDWARD FACE

$$p = q_z G C_p = 49.05 K_z G C_p$$

where  $G = 0.85$  for natural period less than 1-SEC.  
 $C_p = 0.8$  on windward side

$$p = 49.05 K_z (0.85)(0.8) = 33.354 K_z$$

Compute  $p$  for VARIOUS ELEVATIONS

ELEV. (ft)	0	35'	70'	105'	140'
$p$ (psf)	34.36	39.69	44.69	48.03	50.70

COMPUTE WIND PRESSURE ON LEEWARD WALL

$$p = q_z G C_p$$

Use VALUE OF  $q_z$  AT 140 FT. i.e.  $K_z = 1.52$   
 $C_p = -0.5$        $q_z = 49.05 (1.52) = 74.556$

$$p = 74.556 G C_p = 74.556 (0.85) (-0.5)$$


$$p = -31.68 \text{ psf. ANS.}$$

WIND PRESSURE ON SIDE WALLS

$$p = q_z G C_p = 49.05 (1.52)(0.85) (-0.7)$$

$$p = -44.36 \text{ psf}$$

(b) VARIATION OF WIND PRESSURE ON WINDWARD AND LEEWARD SIDES

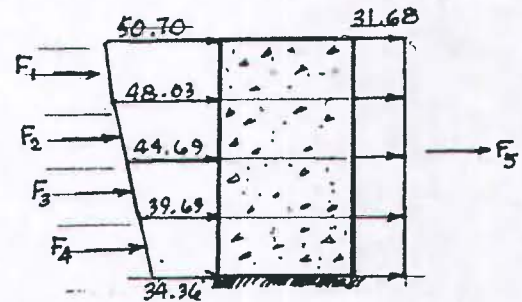

WIND PRESSURES (psf)

COMPUTE TOTAL WIND FORCE (kips)

$$F_1 = \frac{50.7 + 48.03}{2} [35 \times 160] = 276.42 \text{ kips}$$

$$F_2 = \frac{48.03 + 44.69}{2} [35 \times 160] = 259.62 \text{ k}$$

$$F_3 = \frac{44.69 + 39.69}{2} [35 \times 160] = 236.26 \text{ k}$$


$$F_4 = \frac{39.69 + 34.36}{2} [35 \times 160] = 207.34 \text{ k}$$

$$F_5 = \frac{31.68 (140 \times 160)}{1000} = 709.63 \text{ k}$$


$$\text{TOTAL WIND FORCE} = \sum F_1 + F_2 + F_3 + F_4 + F_5$$

$$= 1689.27 \text{ kips}$$


P2.13. Consider the five-story building shown in Figure P2.8. The average weights of the floor and roof are 90 lb/ft<sup>2</sup> and 70 lb/ft<sup>2</sup>, respectively. The values of  $S_{D5}$  and  $S_{D1}$  are equal to 0.9g and 0.4g, respectively. Since steel moment frames are used in the north-south direction to resist the seismic forces, the value of  $R$  equals 8. Compute the seismic base shear  $V$ . Then distribute the base shear along the height of the building.

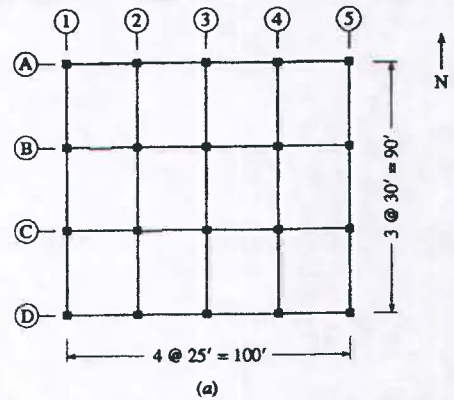

P2.8

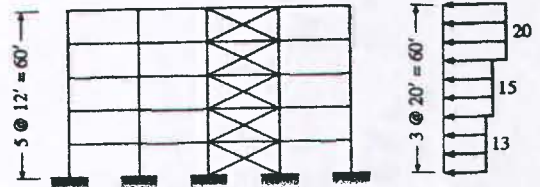

P2.8



**FUNDAMENTAL PERIOD**

$$T = C_t h_n^{3/4}$$

$C_t = 0.035$  for steel moment frames

$$T = 0.035(60)^{3/4}$$

$$T = 0.75 \text{ SEC.}$$

$$W = 4(100 \times 90) 90 \text{ lb/ft}^2 + (100 \times 90) 70 \text{ lb/ft}^2$$

$$= 3,870,000 \text{ lbs} = 3,870 \text{ kips}$$

$$V = \frac{S_{D1} W}{T(R/I)} \quad I = 1 \text{ for office bldgs.}$$

$$V = \frac{0.4(3870)}{0.75(8/1)} = 258 \text{ kips}$$

$$V_{max} = \frac{S_{D3} W}{R/I} = \frac{0.9(3870)}{8/1}$$

$$= 435 \text{ kips}$$

$$V_{min} = 0.0441 I S_{D5} W$$

$$= 0.0441(1)(0.9)(3870)$$

$$= 153.6 \text{ kips}$$

THEREFORE, USE  $V = 258 \text{ kips}$


$$k = 1 + \frac{T - 0.5}{2} = 1.125$$

$$F_x = \frac{W_x h_x^k}{\sum_{i=1}^n W_i h_i^k} V$$

FORCES AT EACH FLOOR LEVEL

FLOOR	WEIGHT $W_i$ (kips)	FLOOR HEIGHT $h_i$ (ft)	$W_i h_i^k$	$\frac{W_x h_x^k}{\sum W_i h_i^k}$	$F_x$ (kips)
Roof	630	60	63,061	0.295	76.1
5th	810	48	63,079	0.295	76.1
4th	810	36	45,638	0.213	55.0
3rd	810	24	28,922	0.135	34.8
2nd	810	12	13,261	0.062	16.0
	$\Sigma = 3,870$		$\Sigma = 213,961$		$\Sigma = 258$

P2.14. (a) A two-story hospital facility shown in Figure P2.14 is being designed in New York with a basic wind speed of 90 mi/h and wind exposure D. The importance factor  $I$  is 1.15 and  $K_z = 1.0$ . Use the simplified procedure to determine the design wind load, base shear, and building overturning moment. (b) Use the equivalent lateral force procedure to determine the seismic base shear and overturning moment. The facility, with an average weight of 90 lb/ft<sup>2</sup> for both the floor and roof, is to be designed for the following seismic factors:  $S_{DS} = 0.27g$  and  $S_{D1} = 0.06g$ ; reinforced concrete frames with an  $R$  value of 8 are to be used. The importance factor  $I$  is 1.5. (c) Do wind forces or seismic forces govern the strength design of the building?

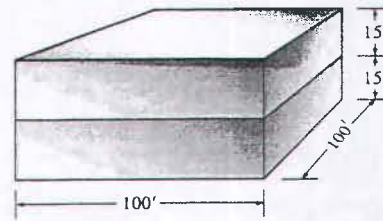


P2.14

(a.) WIND LOADS USING SIMPLIFIED PROCEDURE:

DESIGN WIND PRESSURE  $P_s = \lambda K_{zt} I P_{s30}$   
 $\lambda = 1.66$  TABLE 2.8, MEAN ROOF HEIGHT = 30'

ZONES	$P_{s30}$	$P_s = 1.66(1)1.15P_{s30} = 1.909 P_{s30}$
A	12.8 psf	24.44 psf
C	8.5 psf	16.22 psf

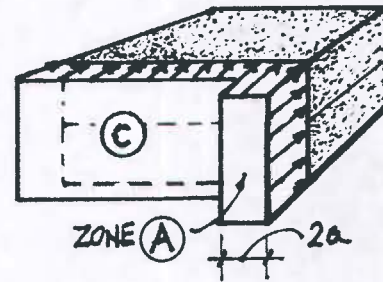

RESULTANT FORCE AT EACH LEVEL; WHERE  
 DISTANCE  $a = 0.1(100') = 10'$ ;  $0.4(30') = 12'$ ; 3'

$a = 10'$  CONTROLS  $\frac{1}{2} 2a = 20'$  REGION (A)

FRONT: ZONE (A) :  $\frac{15'}{2} (24.44 \text{ psf}) 20' / 1000 = 3.67 \text{ k}$   
 ZONE (C) :  $\frac{15'}{2} (16.3 \text{ psf}) 80' / 1000 = 9.78 \text{ k}$

FRONT RESULTANT = 13.45 k

F<sub>2ND</sub>: ZONE (A) :  $15' (24.44 \text{ psf}) 20' / 1000 = 7.33 \text{ k}$   
 ZONE (C) :  $15' (16.3 \text{ psf}) 80' / 1000 = 19.56 \text{ k}$

F<sub>2ND</sub> RESULTANT = 26.89 k

BASE SHEAR  $V_{\text{BASE}} = F_{\text{FRONT}} + F_{\text{2ND}} = 40.34 \text{ k}$

OVERTURNING MOMENT  $M_{o.t.} = \sum F_i h_i$

$M_{o.t.} = 13.45 \text{ k} (30') + 26.89 \text{ k} (15') = 806.9 \text{ ft.k}$

P2.14 CONTINUED

## P2.14 CONTINUED

### (b) SEISMIC LOADS BY EQUIVALENT LATERAL FORCE PROCEDURE

GIVEN:  $W = 90 \text{ PSF FLOOR \& ROOF}$ ;  $S_{D3} = 0.27g$ ,  $S_{D1} = 0.06g$ ;  $R = 8$ ,  $I = 1.5$

$$\text{BASE SHEAR } V_{\text{BASE}} = \frac{S_{D1} W}{T(R/I)}$$

WHERE  $W$  TOTAL BUILDING DEAD LOAD =

$$W_{\text{ROOF}} = 90 \text{ PSF } (100')^2 = 900 \text{ k}$$

$$W_{\text{2ND}} = 90 \text{ PSF } (100')^2 = 900 \text{ k}$$

$$W_{\text{TOTAL}} = 1800 \text{ k}$$

$$\text{AND } T = C_T h_n^x = 0.342 \text{ SEC.}$$

$C_T = 0.016$  REINF. CONCRETE FRAME

$X = 0.9$  " " "

$h = 30'$  BUILDING HEIGHT

$$V_{\text{BASE}} = \frac{0.06 (1800 \text{ k})}{(0.342 \text{ SEC})(8/1.5)} = 0.033 W = 59.2 \text{ k}$$

CONTROLS

$$V_{\text{MAX.}} = \frac{S_{D3} W}{R/I} = \frac{0.27 (1800 \text{ k})}{(8/1.5)} = 0.051 W = 91.1 \text{ k}$$

$$V_{\text{MIN.}} = 0.044 S_{D3} I W = 0.044 (0.27)(1.5)(1800 \text{ k})$$
$$= 0.0178 W = 32.1 \text{ k}$$

FORCE @ EACH LEVEL  $F_x = \frac{W_i h_i^k}{\sum W_i h_i^k} V_{\text{BASE}}$ , WHERE  $V_{\text{BASE}} = 59.2 \text{ k}$

$T < 0.5 \text{ SEC.}$  THUS  $k = 1.0$

LEVEL	$W_i$	$h_i$	$W_i h_i^k$	$W_i h_i^k / \sum W_i h_i^k$	FORCE @ EA. LEVEL:
ROOF	900 k	30'	27000	0.667	$F_{\text{ROOF}} = 39.5 \text{ k}$
2ND	900 k	15'	13500	0.333	$F_{\text{2ND}} = 19.76 \text{ k}$
			$\sum W_i h_i^k = 40500$		$\sum F_x = V_{\text{BASE}} = 59.2 \text{ k}$

OVERTURNING MOMENT  $M_{O.T.} = \sum F_x h_i$

$$M_{O.T.} = 39.5 \text{ k}(30') + 19.76 \text{ k}(15') = \underline{1,481.4 \text{ FT}\cdot\text{K}}$$

(c) SEISMIC FORCES GOVERN THE LATERAL STRENGTH DESIGN.

P2.15. When a moment frame does not exceed 12 stories in height and the story height is at least 10 ft, the ASCE standard provides a simpler expression to compute the approximate fundamental period:

$$T = 0.1N$$

---

where  $N$  = number of stories. Recompute  $T$  with the above expression and compare it with that obtained from Problem P2.13. Which method produces a larger seismic base shear?

ASCE APPROXIMATE FUNDAMENTAL PERIOD:

$$T = 0.1N$$

$$N = 5 \quad \therefore T = 0.5 \text{ SECONDS}$$

$$V = \frac{0.3 \times 6750}{0.5 (5/1)} = 810 \text{ KIPS}$$

THE SIMPLER APPROXIMATE METHOD PRODUCES A LARGER VALUE OF BASE SHEAR.